


SECTION 101.30

NON-RESIDENTIAL IRRIGATION SUB-METER

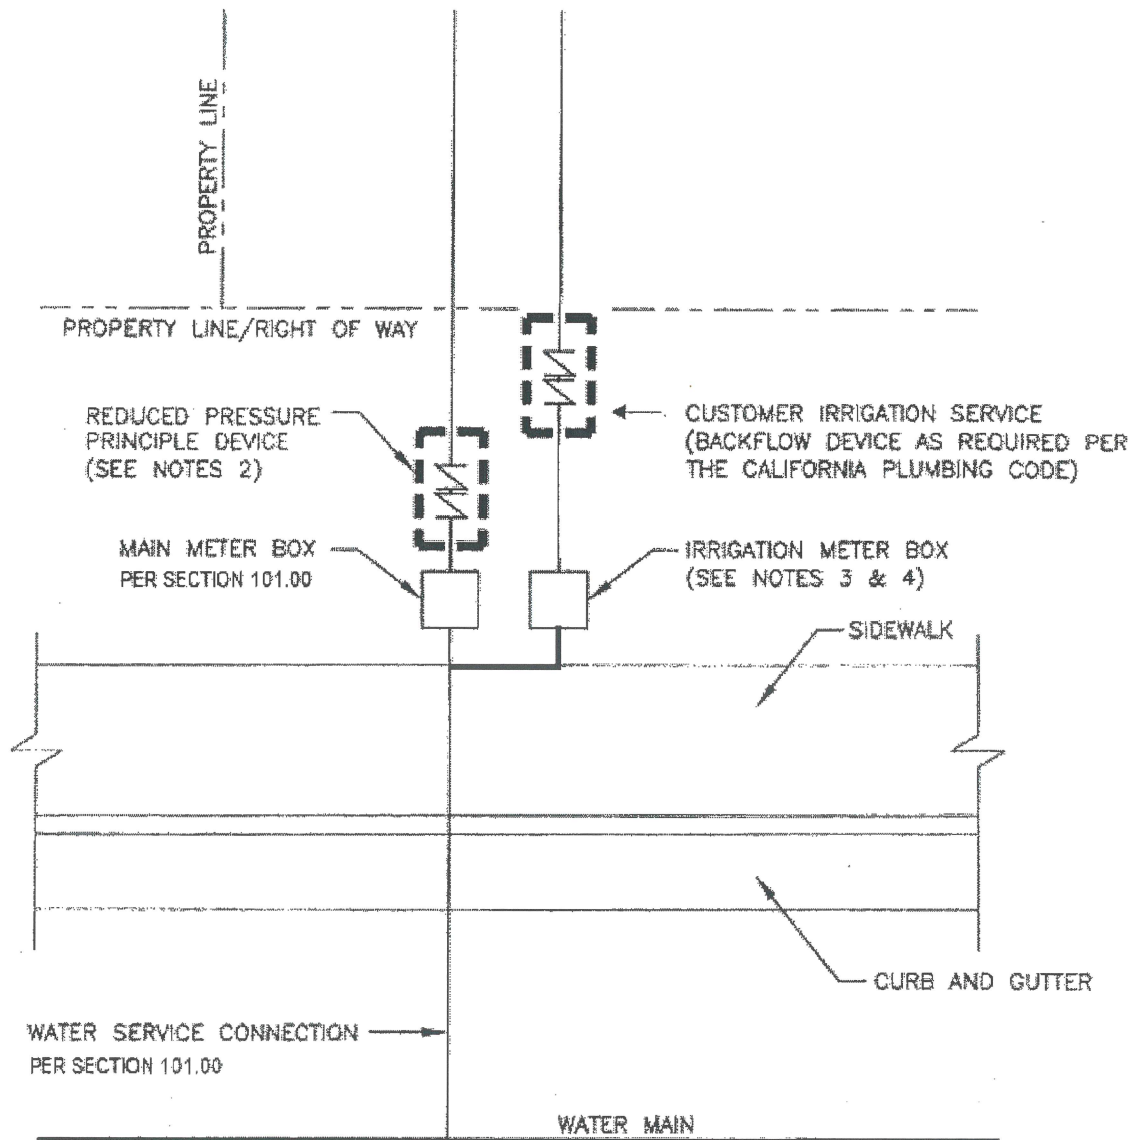

NOTES:

1. All materials shall be per Section 100.00 and shall be installed in accordance with the appropriate standards as listed.
2. An approved reduced pressure principle (RPP) device shall be located as close as practical (3 feet max.) from the back of the main water meter per Section 131.00.
3. Irrigation meter shall be purchased from the District by the customer/owner and shall be classified as a sub-meter. The sub-meter will be installed and maintained by the District.
4. Irrigation sub-meter shall be located within the District's Right-of-Way.