


## SECTION 141.40

### AIR GAP SEPARATION DETAIL

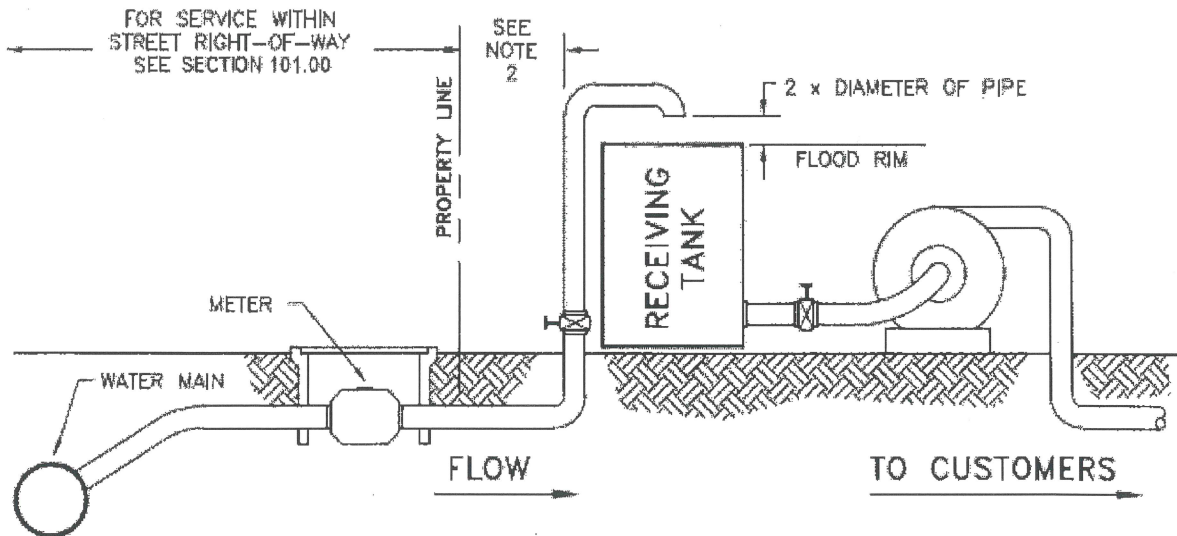

### AIR GAP SEPARATION

#### NOTES:

1. Backflow Devices are required under State of California Administrative Code, Title 17, and shall be installed in accordance thereof.
2. Receiving tank shall be located as close to property line as practical. Location to be approved by the District's Engineer.
3. No connections or tee shall be allowed in service line between meter and receiving tanks.
4. Service pipe to receiving tank shall be 1 inch minimum.