



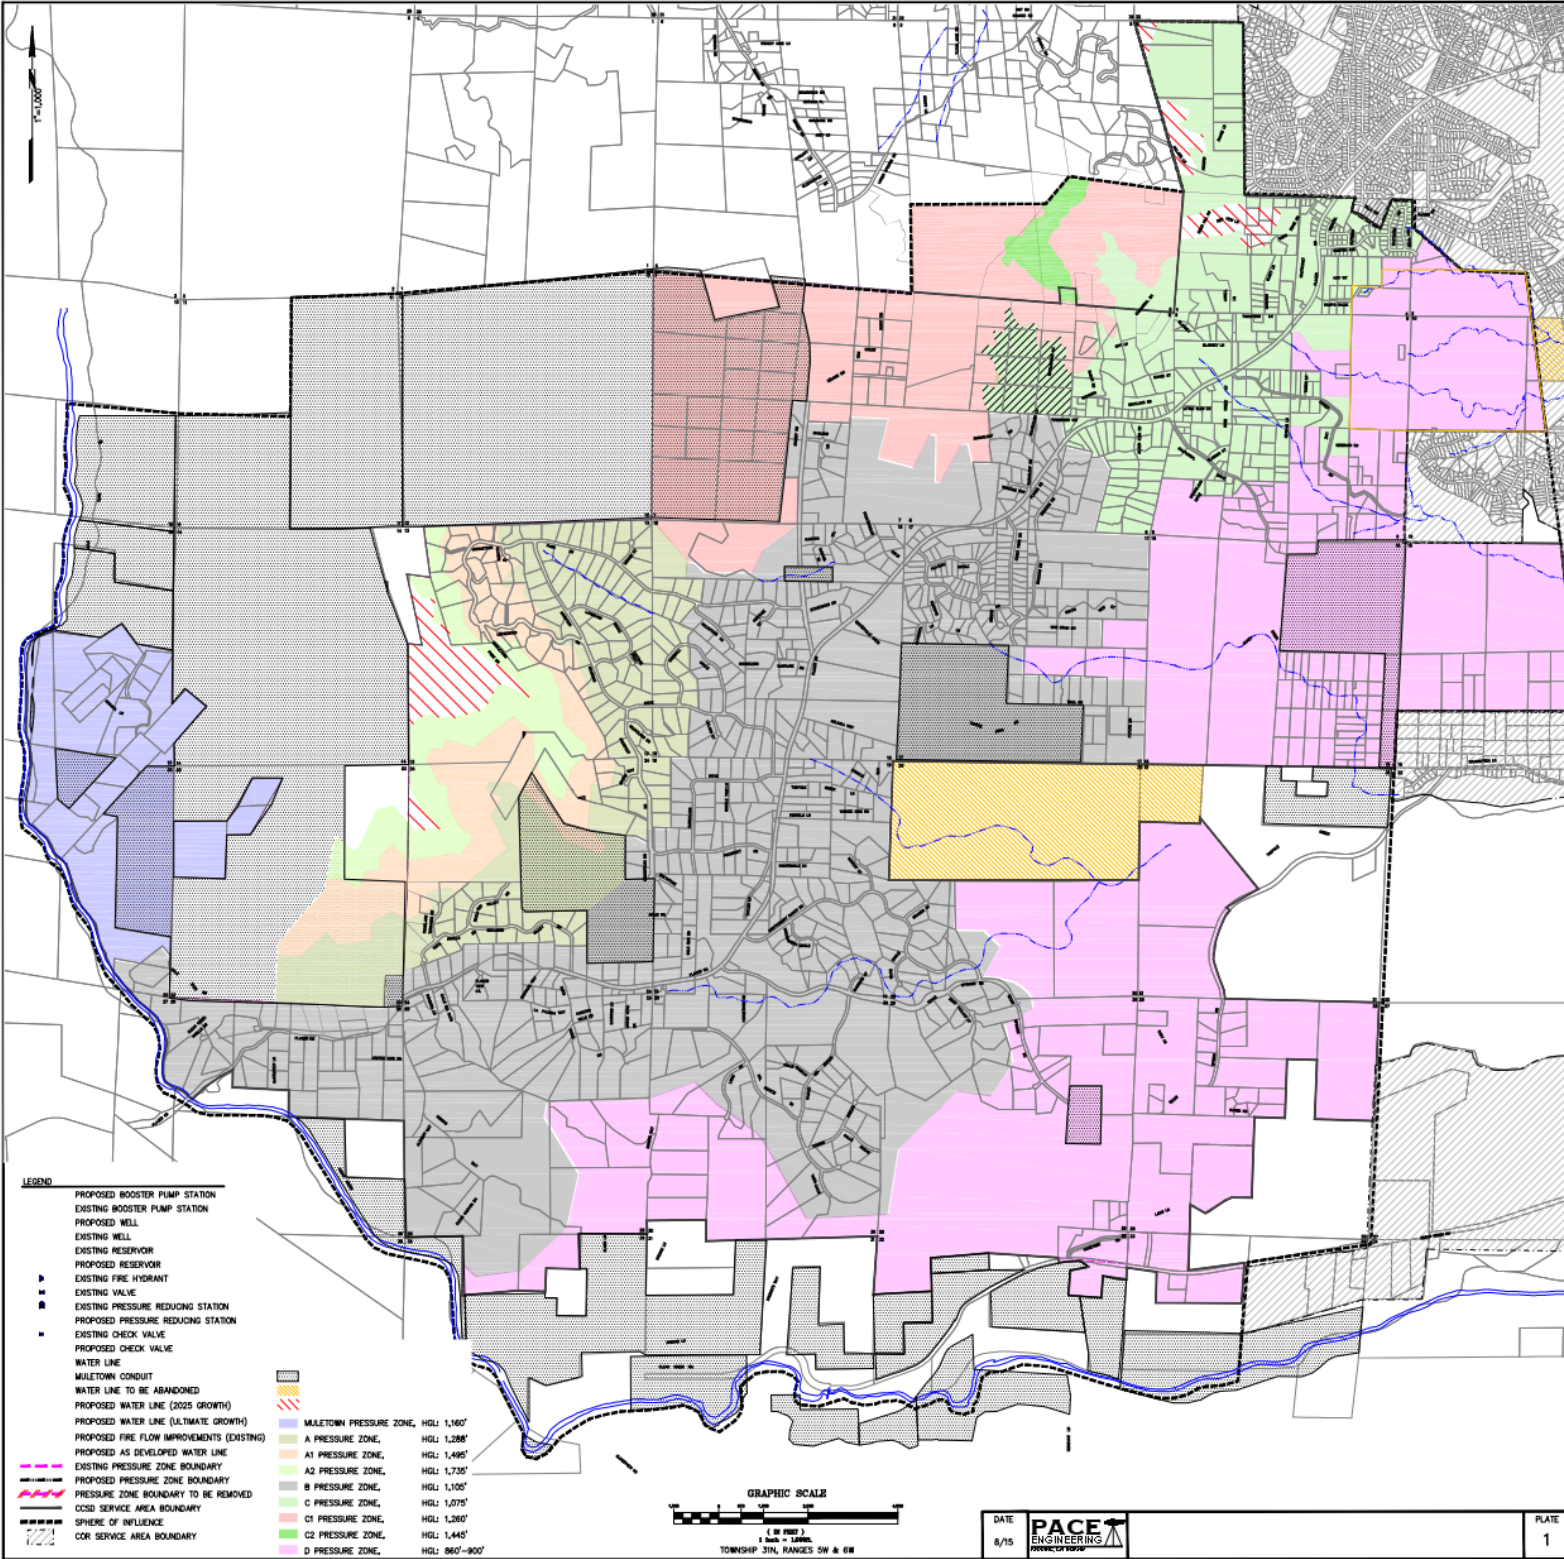

- LEGEND**
- PROPOSED BOOSTER PUMP STATION
 - EXISTING BOOSTER PUMP STATION
 - PROPOSED WELL
 - EXISTING WELL
 - EXISTING RESERVOIR
 - PROPOSED RESERVOIR
 - EXISTING FIRE HYDRANT
 - EXISTING VALVE
 - EXISTING PRESSURE REDUCING STATION
 - PROPOSED PRESSURE REDUCING STATION
 - EXISTING CHECK VALVE
 - PROPOSED CHECK VALVE
 - WATER LINE
 - MALETOWN CONDUIT
 - WATER LINE TO BE ABANDONED
 - PROPOSED WATER LINE (2025 GROWTH)
 - PROPOSED WATER LINE (ULTIMATE GROWTH)
 - PROPOSED FIRE FLOW IMPROVEMENTS (EXISTING)
 - PROPOSED AS DEVELOPED WATER LINE
 - EXISTING PRESSURE ZONE BOUNDARY
 - PROPOSED PRESSURE ZONE BOUNDARY
 - PRESSURE ZONE BOUNDARY TO BE REMOVED
 - COSE SERVICE AREA BOUNDARY
 - SPHERE OF INFLUENCE
 - COR SERVICE AREA BOUNDARY

	MALETOWN PRESSURE ZONE, HGL: 1,160'
	A PRESSURE ZONE, HGL: 1,288'
	A1 PRESSURE ZONE, HGL: 1,495'
	A2 PRESSURE ZONE, HGL: 1,730'
	B PRESSURE ZONE, HGL: 1,105'
	C PRESSURE ZONE, HGL: 1,075'
	C1 PRESSURE ZONE, HGL: 1,260'
	C2 PRESSURE ZONE, HGL: 1,445'
	D PRESSURE ZONE, HGL: 860'-900'



DATE
8/15

PACE ENGINEERING
PROVIDING SOLUTIONS

PLATE
1